


Flow Chart for iPS Cell Derivation, Quality Control & Optional Gene Editing

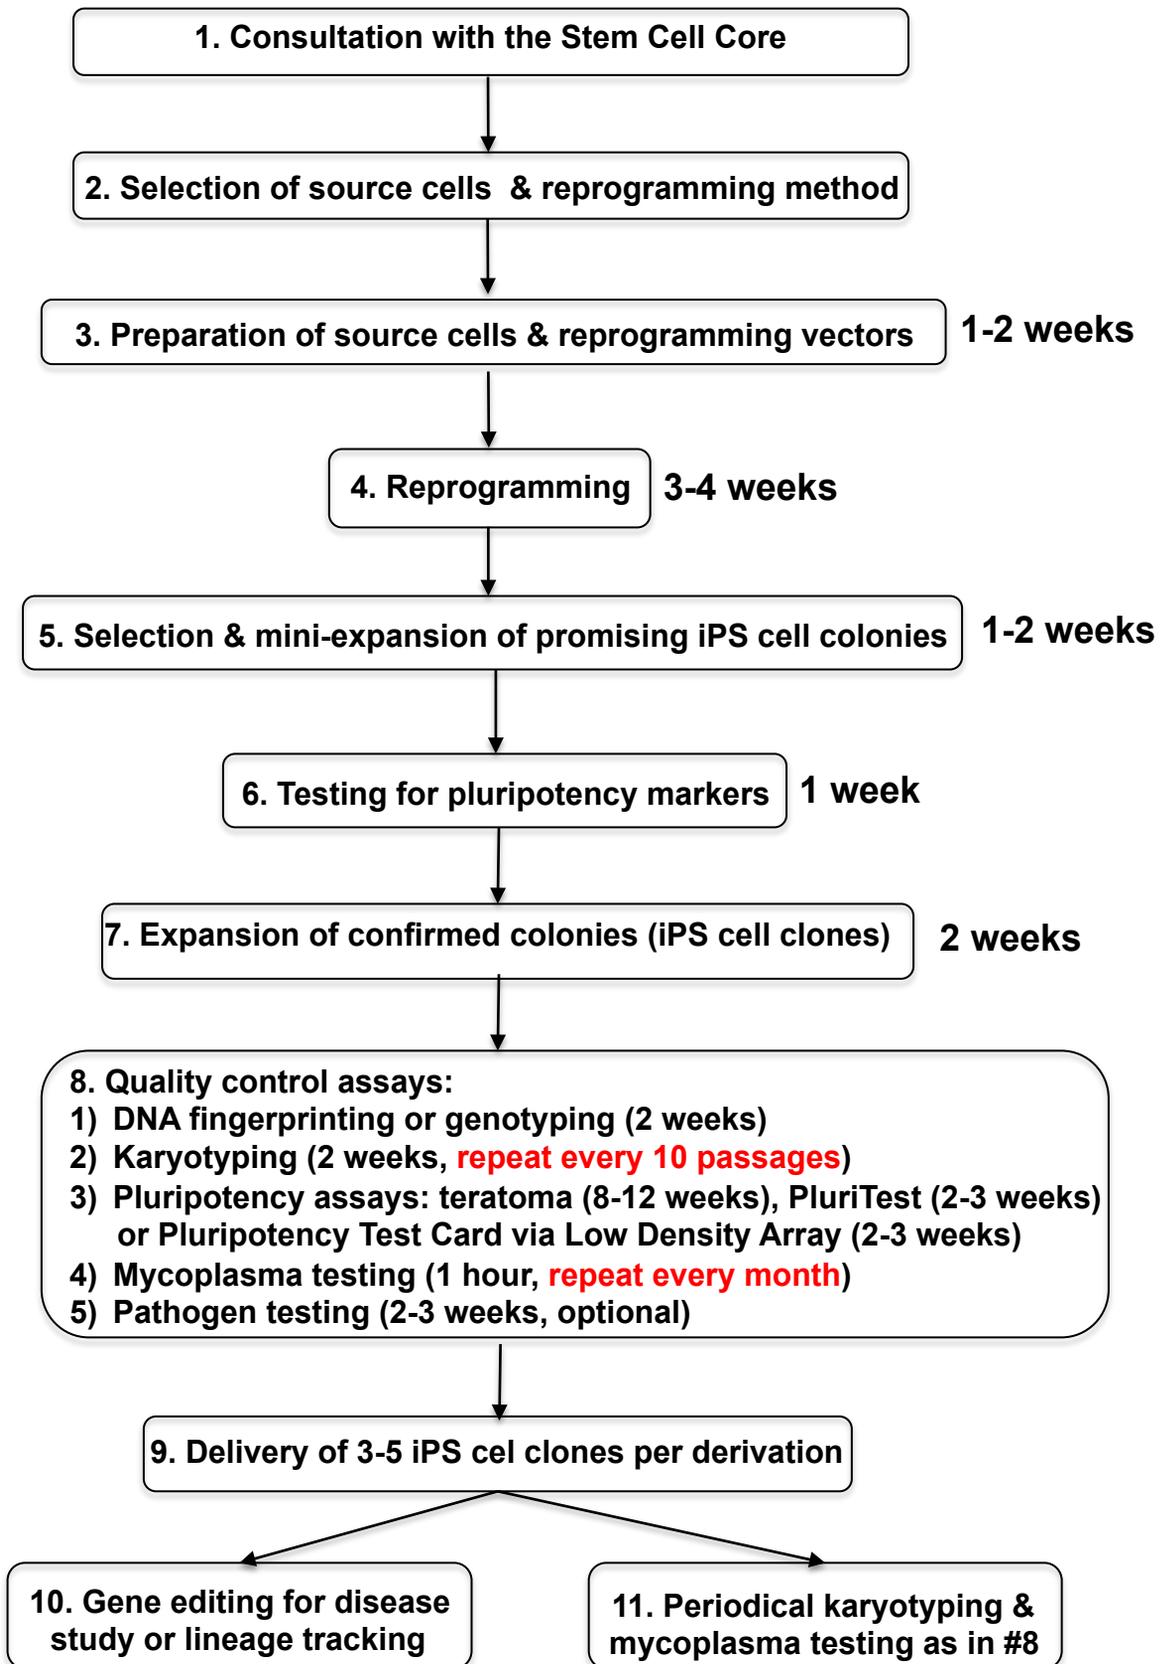

Total: 9-14 weeks (or 15-21 weeks including teratoma assay) by #9